


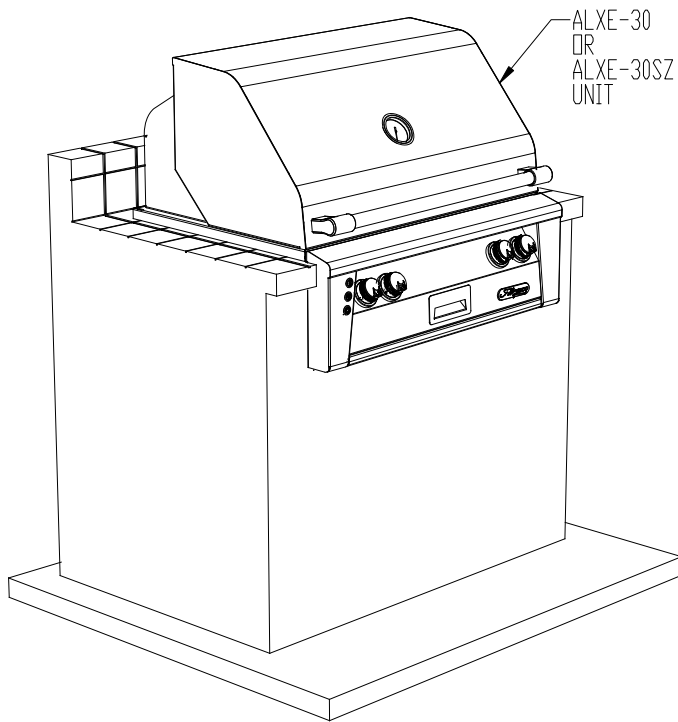
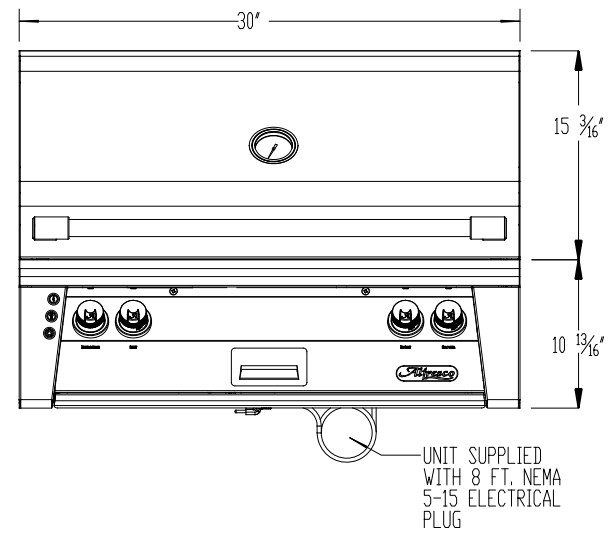
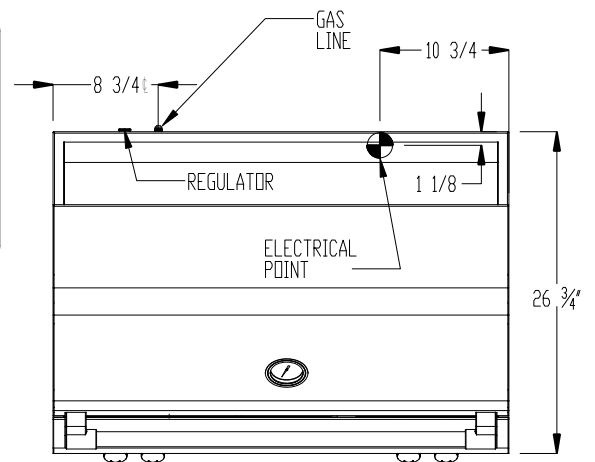


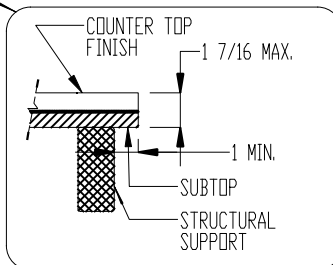

TYPICAL ALXE-30 / 30SZ INSTALLATION

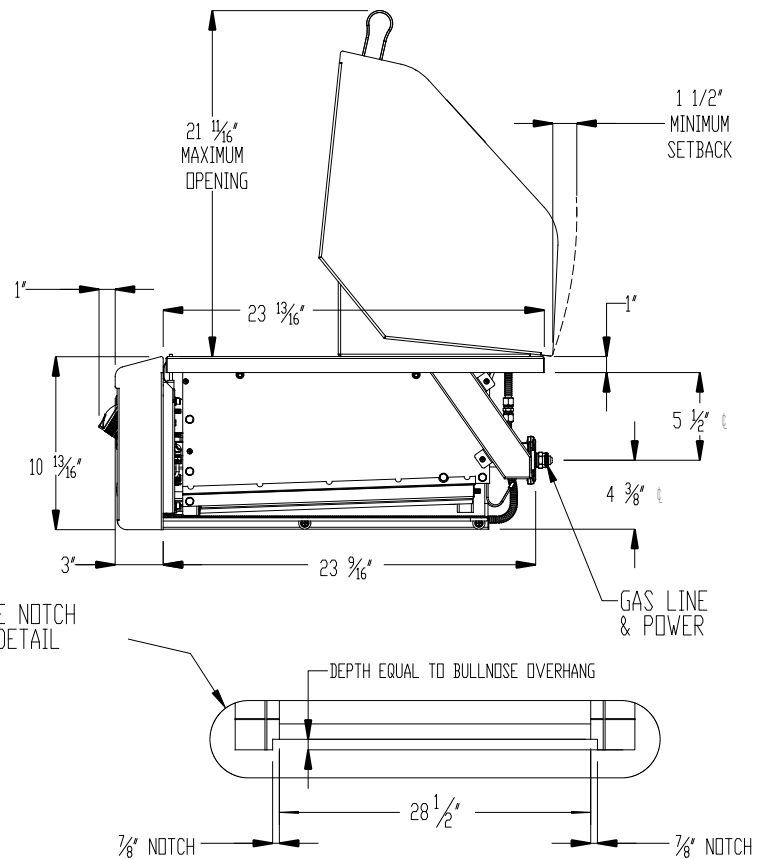

COUNTERTOP CUTOUT REQUIREMENTS

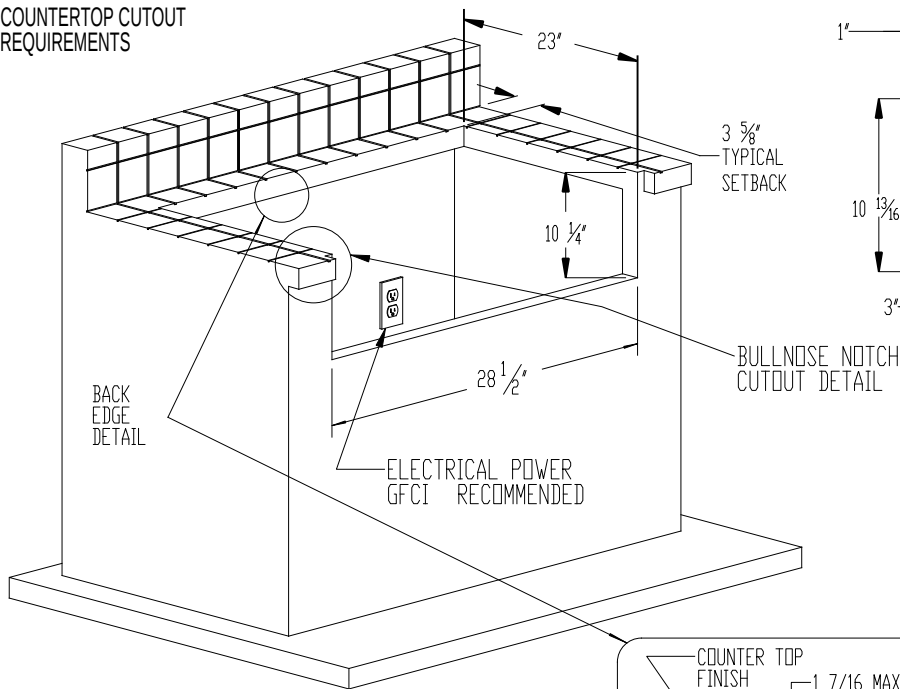

NOTE:

° CUTOUT SHOWN FOR NON - COMBUSTIBLE
CONSTRUCTION ONLY. OTHERWISE USE
OF AIJ-42 INSULATING JACKET IS REQUIRED.

° COUNTER MUST HAVE PROPER GAS AND
POWER SUPPLIES FOR YOUR ALFRESCO BBQ.

SPECIFICATIONS:
BTUH = 77,000
FUEL = NG @ 5 W.C. OR LP @ W.C.
ELECTRICAL POWER = 115 VAC / 1.44 AMPS / 60 HZ.
GAS CONNECTION = $\frac{1}{2}$ " NPT (NG) OR $\frac{3}{8}$ " ODF (LP)

Alfresco

SUPERIOR EQUIPMENT SOLUTIONS
7039 EAST SLAUSON AVENUE
COMMERCE, CA. 90040

THE INFORMATION CONTAINED IN THIS DRAWING IS THE
SOLE PROPERTY OF SUPERIOR EQUIPMENT SOLUTIONS,
INC. ANY REPRODUCTION IN PART OR AS A WHOLE
WITHOUT WRITTEN PERMISSION FROM SUPERIOR
EQUIPMENT SOLUTIONS, INC. IS PROHIBITED.

DRAWN BY: Jorge Pelayo
CREATED: Tuesday, June 23, 2015

PROJECT TITLE:
ALFRESCO GRILLS

DRAWING TITLE:
ALXE-30 / 30 SZ SPECIFICATIONS

DRAWING NO.: ALXE-30 SPEC SHEET
SHEET 1 OF 1