


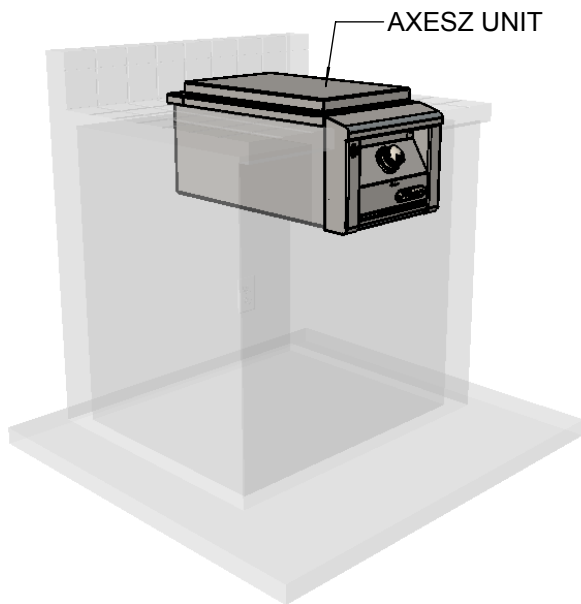


AXESZ TYPICAL INSTALLATION

COUNTERTOP CUTOUT REQUIREMENTS

NOTE 1:
A GAS LINE IS REQUIRED INSIDE THE COUNTER FOR OPERATION.



IT IS RECOMMENDED THAT A FLEXIBLE GAS LINE IS USED TO EASE INSTALLATION IN NATURAL GAS (NG) SETUPS. (SEE NOTE 2 IN REGARDS TO LP SETUPS)

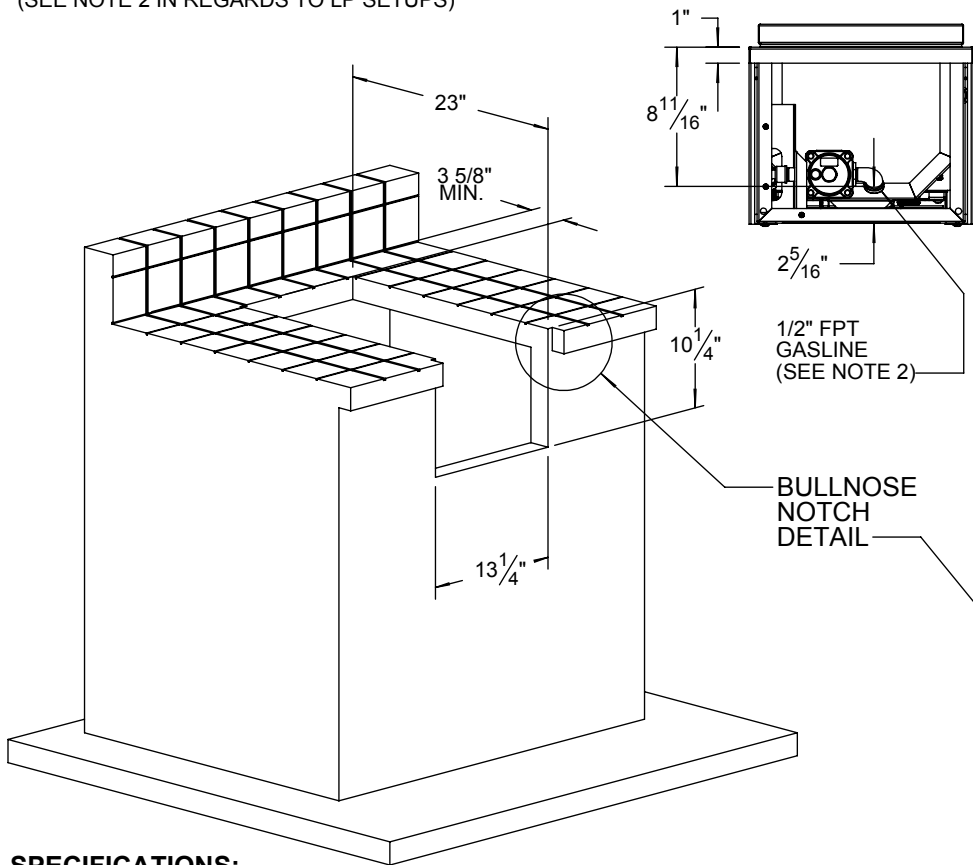


SPECIFICATIONS:

BTUH = 28,200
FUEL - NG @ 5 W.C. OR LP @ 10 W.C.
ELECTRICAL POWER - 9 VDC BATTERY
GAS CONNECTION = 1/2" NPT (NG) OR 3/8" ODF (LP)

AXESZ - SEAR-ZONE™ SIDE BURNER

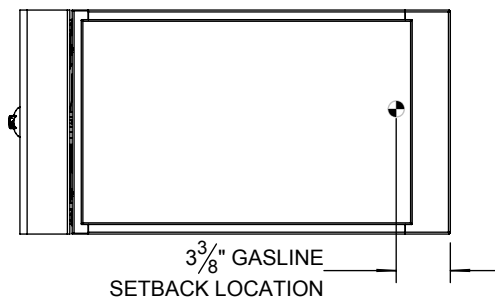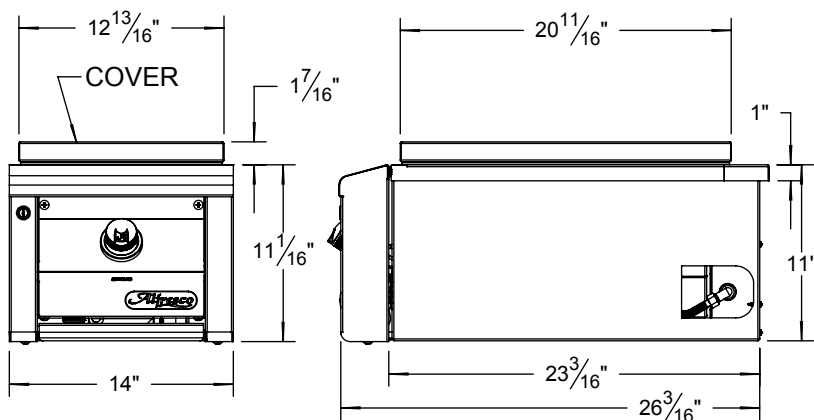


LP GAS SETUP:

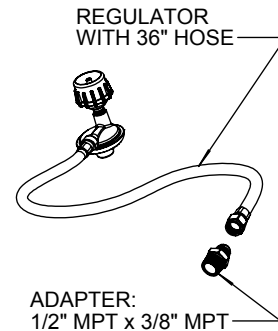

NOTE 2:
STANDARD UNIT HAS A NATURAL GAS (NG) CONNECTION WITH 1/2" FPT FITTING.

IF LIQUID PROPANE (LP) OPTION IS ORDERED, THE UNIT IS SUPPLIED WITH A REGULATOR, HOSE AND ADAPTER FITTING AS SHOWN.

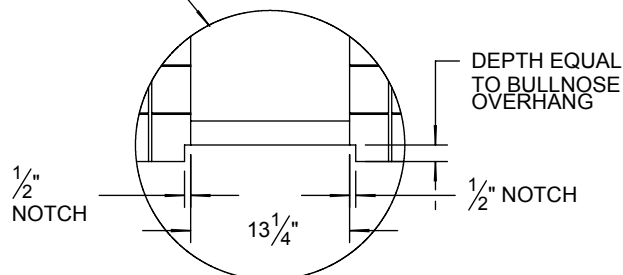

Alfresco

SUPERIOR EQUIPMENT SOLUTIONS
7039 EAST SLAUSON AVENUE
COMMERCE, CA. 90040

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SUPERIOR EQUIPMENT SOLUTIONS INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION FROM SUPERIOR EQUIPMENT SOLUTIONS, INC. IS PROHIBITED.

DRAWN BY: ADRIAN CRISCI
CREATED: 08/19/2015

PROJECT TITLE: AXESZ

DRAWING TITLE:

AXESZ - SIDE BURNER SPECIFICATIONS

DRAWING NO.:

AXESZ - SPEC SHEET

SHEET 1 OF 1