


LOUNGE CHAIR

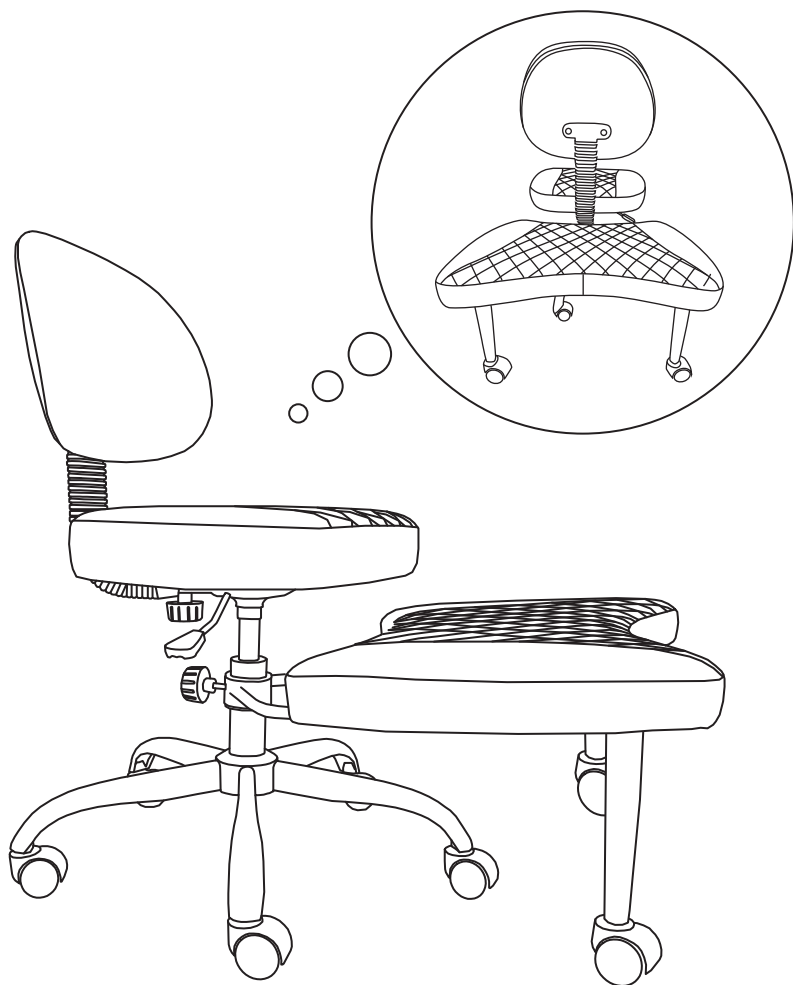

Please read and understand all instructions before use.

Installation Guide

1. Before installation, please read the instructions carefully and familiarize yourself with the installation steps and methods.
2. Before installation, ensure all accessories (screws, handrails, wheels, etc.) are complete and undamaged.
3. Install the product on a flat surface in a well-lit environment.
4. The gas lift must be installed in an upright position; inversion is prohibited.
5. Use the provided tools, and for heavier parts, two people are recommended to work together.
6. After installation, check that all parts are securely fastened.

Precautions for Use


1. Only adjust the seat using the handle adjuster. Do not disassemble the gas lift.
2. Do not exceed the maximum load capacity (330 lbs). Ensure the seat is placed on a stable surface and avoid impacts.
3. Keep children away from climbing or playing on the chair to prevent tipping.

Maintenance


1. Clean with a soft cloth and neutral cleaner. Avoid alcohol or corrosive solvents.
2. Regularly check screws, the gas lift, and other components to prevent loosening.
3. Remove debris wrapped around the wheel legs periodically.
4. Avoid prolonged exposure to sunlight or damp storage to prevent color fading or rust.

After-Sales Service


1. If you encounter installation or usage issues, contact online customer service.
2. If you notice any damage upon delivery, take photos immediately and contact online customer service. The receiving photos will serve as proof.
3. If accessories are missing or damaged after unpacking, take photos and contact online customer service for replacements.




A/ Backrest




B/ Seat



C/ Footrest



D/ Control unit




E/ Footrest iron frame



F/ Support foot x2



G/ Foot x5



H/ Base



I/ Caster x7



J/ Gas lift



K/ Knob x2

Screws and Other Parts

1



M5*8

x1

2



M6*16

x5

3



M6*20

x12

4




Allen key

x1


1 Installation of Base

- ① Remove the plastic cover from the base.
- ② Insert each of the five feet into the base and secure with screws.

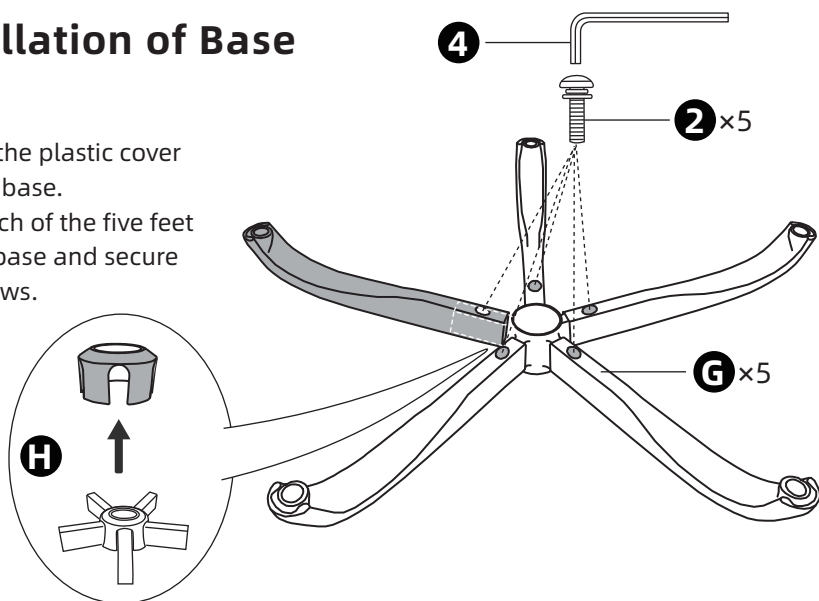


2 Installation of Casters and Plastic Cover

- ① Turn the base over and insert the five nylon casters into the slots on the bottom of the base.
- ② Insert the plastic cover into the center of the base.

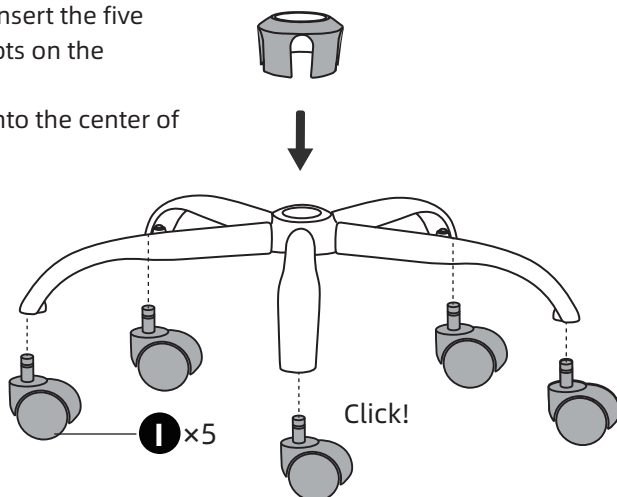


3 Installation of Footrest Iron Frame

- ① Insert the iron frame into the slider on the footrest and secure with one screw.

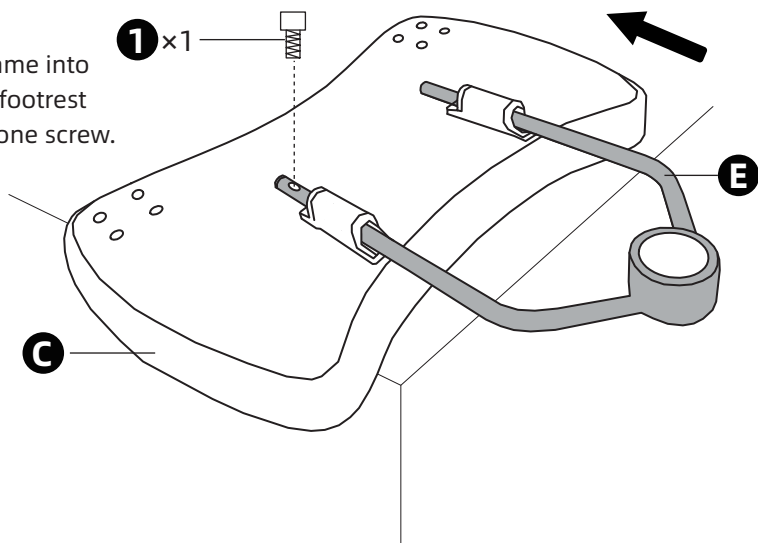


4 Installation of Support Foot

- ① Insert the two nylon casters into the bottom of the support legs.
② Attach the support legs to the footrest.

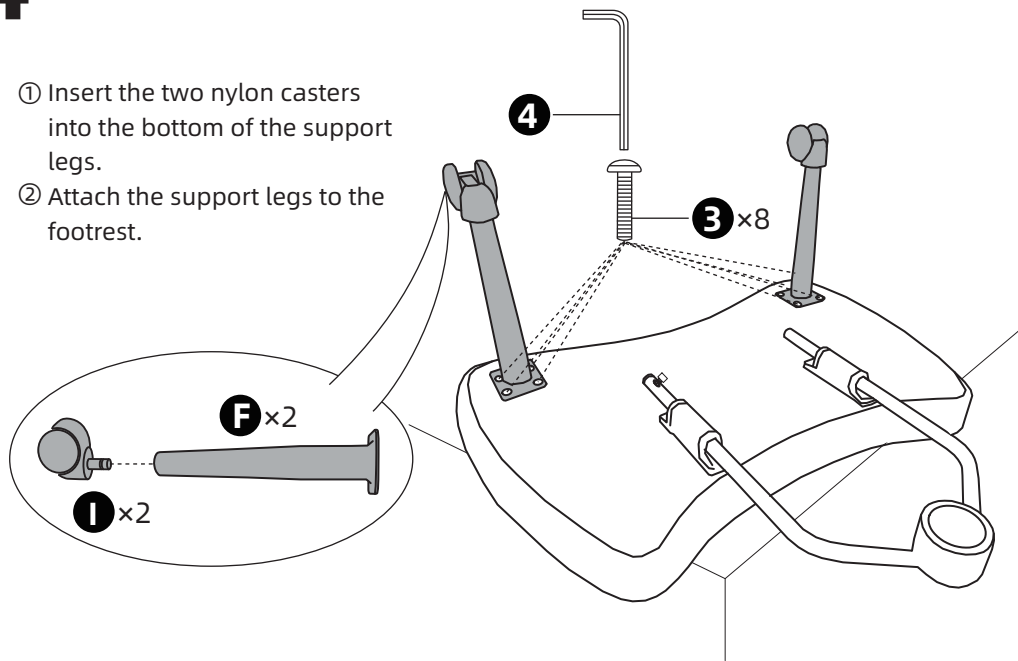

5 Installation of Gas lift and Knob


- ① Insert the gas lift into the footrest and the base in turn.
- ② Secure the gas lift with the knob as shown.

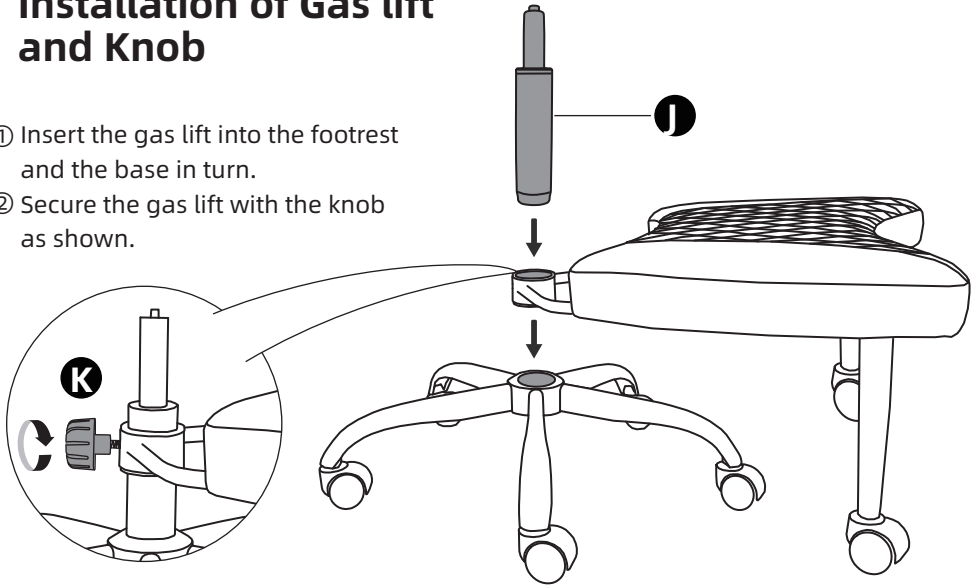

6 Installation of Control Unit to Seat


- ① Finger-tighten all screws to 80%.
- ② Fully tighten after all are in place.

Note: The mounting direction of the control unit can be determined by the "FRONT" sticker on the seat and control unit.

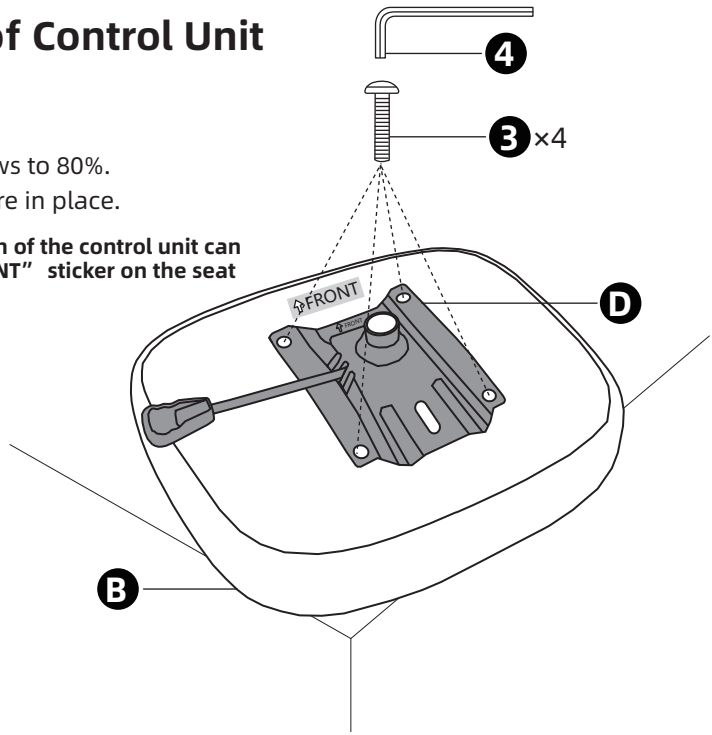


7 Combination of Seat and Backrest

- ① Insert the backrest into the control unit and secure it with the knob.

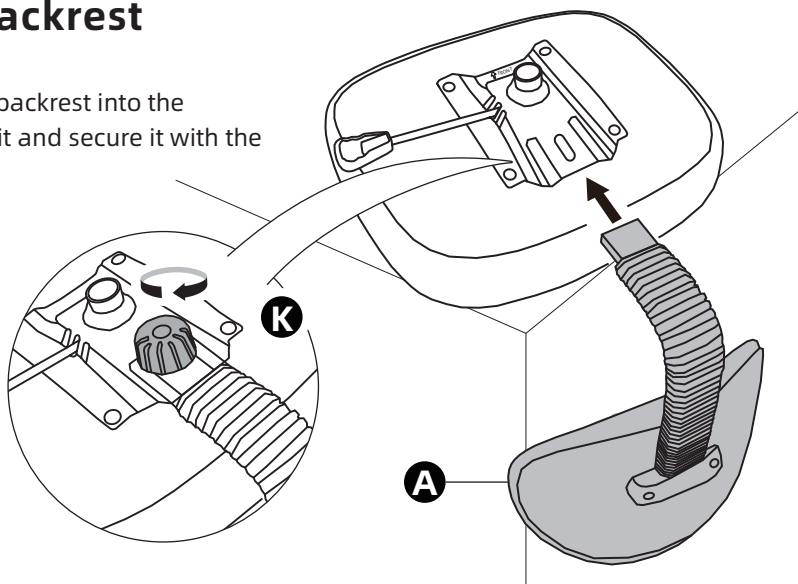


8 Attachment of Seat to Gas Lift

- ① Align and connect the two parts vertically.

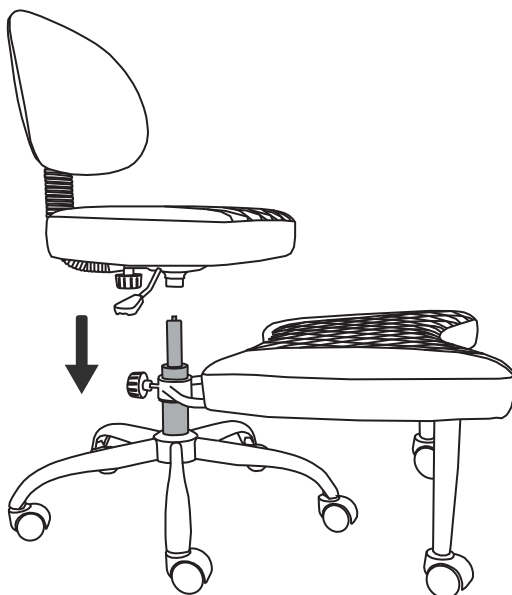


Seat Height Adjustment and 360° Rotation

- ① The chair is equipped with 10 cm (4 inches) of lift adjustment, allowing users to adjust the optimal sitting height according to their height needs.
- ② With the 360° flexible swivel base and quiet wheels, it realizes smooth multi-angle free steering, enjoying the freedom of changing sitting positions as you wish.

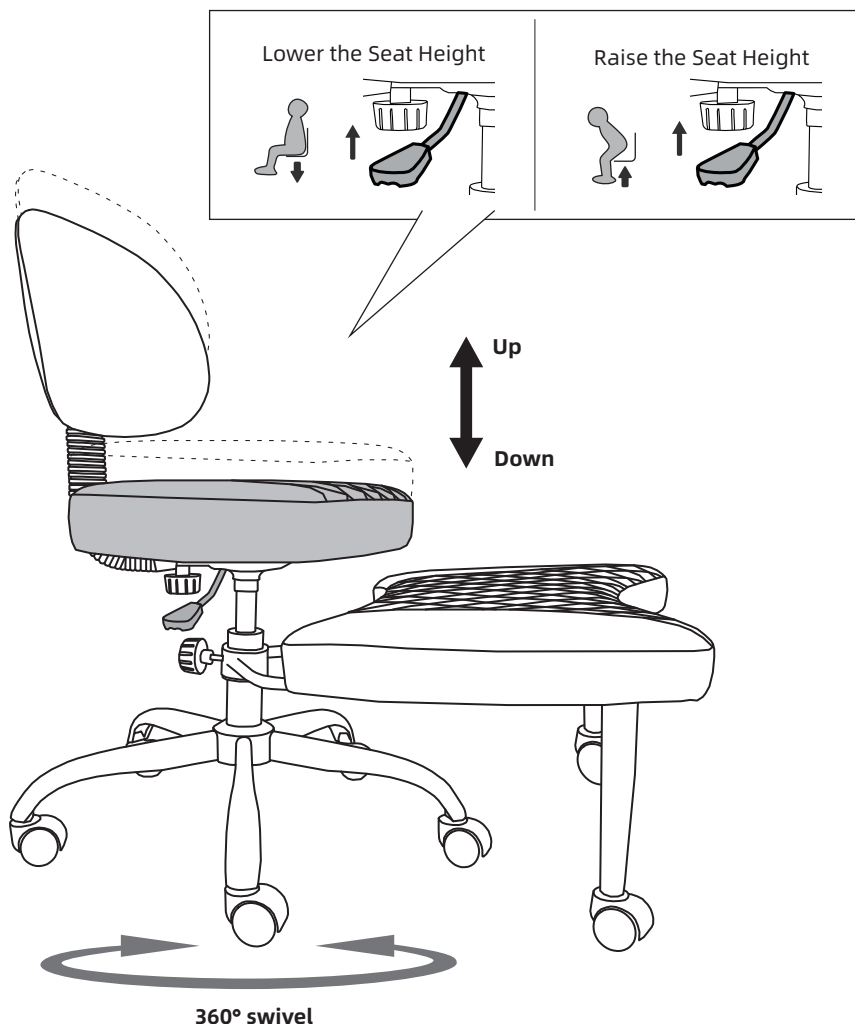


Retractable Footrest and 360° Rotation

- ① Designed for multiple seating positions, it is suitable for cross-legged, squatting and kneeling postures, and is equipped with 360° swivel and retractable footrest to meet the needs of yoga practitioners, meditation enthusiasts and dynamic seating postures, providing flexible support and ergonomic comfort experience.

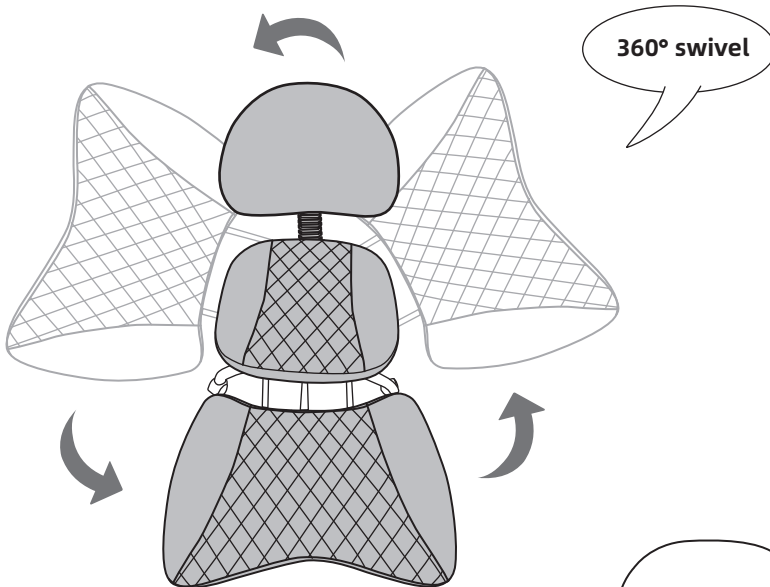

- ② Note: Limited load-bearing capacity of the footrest, no sitting is allowed.

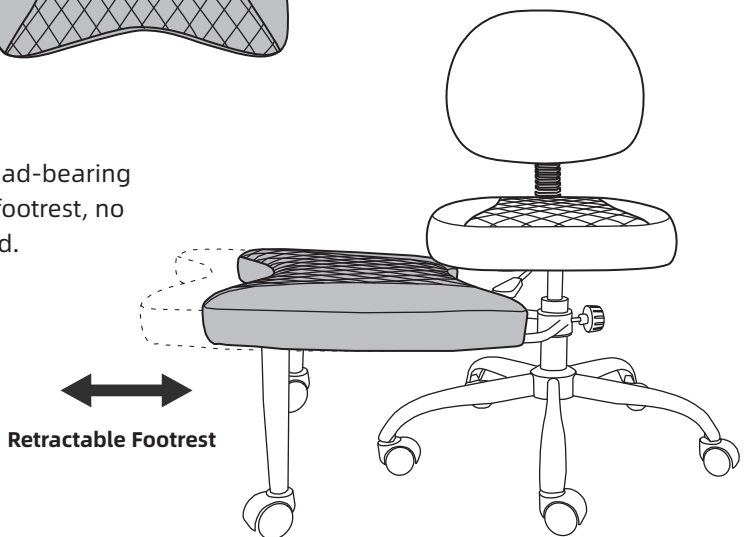

the 1990s, the number of people in the UK who are employed in the public sector has increased by 1.5 million (1990–1999) (Department of Health 2000).

There is a growing emphasis on the need to improve the quality of care in the public sector. The Department of Health (2000) has set out a number of key objectives for the public sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system. The Department of Health (2000) has also set out a number of key objectives for the private sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the voluntary sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the independent sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the private sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the voluntary sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the independent sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the private sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the voluntary sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.


The Department of Health (2000) has also set out a number of key objectives for the independent sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the private sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the voluntary sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

The Department of Health (2000) has also set out a number of key objectives for the independent sector, including the need to improve the quality of care, to reduce the waiting time for treatment, to improve the efficiency of the system, and to improve the financial performance of the system.

SILLA DE SALÓN

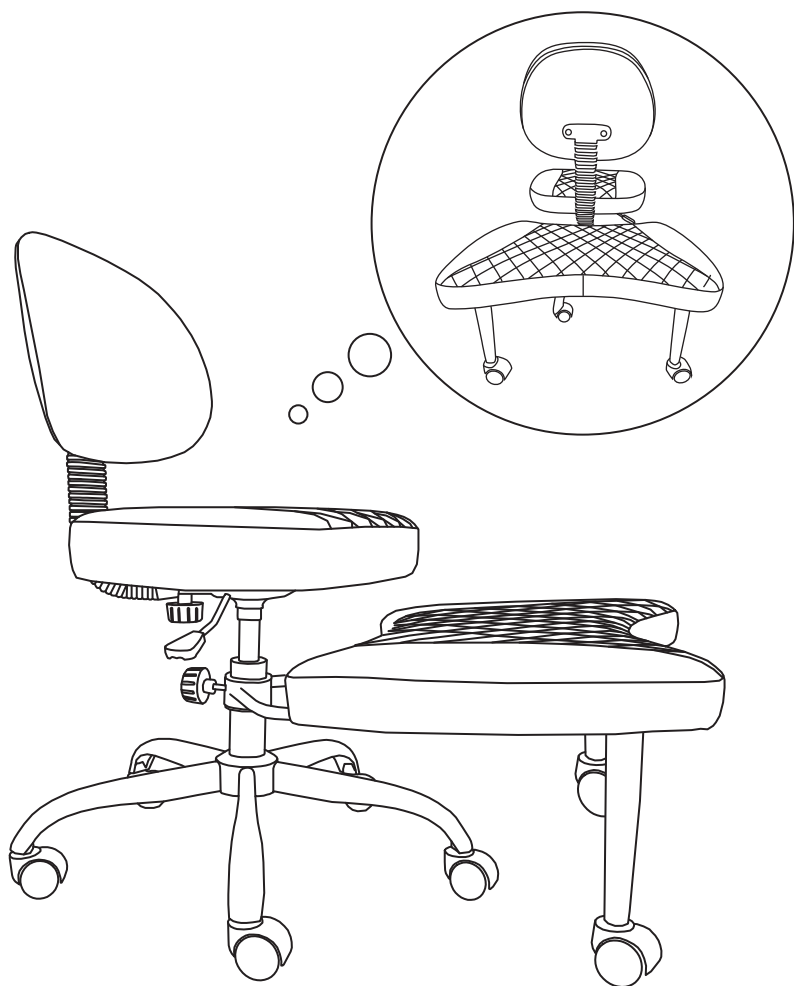

Lea y comprenda todas las instrucciones
antes de usar el producto.

Guía de instalación

1. Antes de la instalación, lea atentamente las instrucciones y familiarícese con los pasos y métodos de instalación.
2. Antes de la instalación, asegúrese de que todos los accesorios (tornillos, pasamanos, ruedas, etc.) estén completos y sin daños.
3. Instale el producto sobre una superficie plana en un entorno bien iluminado.
4. La grúa de gas debe instalarse en posición vertical; está prohibida la inversión.
5. Utilice las herramientas suministradas, y para las piezas más pesadas, se recomienda que dos personas trabajen juntas.
6. Después de la instalación, compruebe que todas las piezas estén bien sujetas.

Precauciones de uso


1. Ajuste el asiento únicamente con el regulador de la empuñadura. No desmonte el elevador de gas.
2. No supere la capacidad de carga máxima (330 lbs). Asegúrese de que el asiento está colocado sobre una superficie estable y evite los impactos.
3. Evite que los niños se suban o jueguen en la silla para evitar vuelcos.

Mantenimiento


1. Limpie con un paño suave y un limpiador neutro. Evite el alcohol o disolventes corrosivos.
2. Compruebe regularmente los tornillos, el elevador de gas y otros componentes para evitar que se aflojen.
3. Retire periódicamente los residuos que envuelven las patas de las ruedas.
4. Evite la exposición prolongada a la luz solar o el almacenamiento en húmedo para evitar la pérdida de color o la oxidación.

Servicio postventa


1. Si tiene problemas de instalación o uso, póngase en contacto con el servicio de atención al cliente en línea.
2. Si observa algún daño en el momento de la entrega, haga fotos inmediatamente y póngase en contacto con el servicio de atención al cliente en línea. Las fotos de la recepción servirán como prueba.
3. Si faltan accesorios o están dañados después de desembalarlos, haga fotos y póngase en contacto con el servicio de atención al cliente en línea para que se los cambien.




A/ Respaldo




B/ Asiento



C/ Reposapiés



D/ Unidad de control




E/ Reposapiés
marco de hierro



F/ Pie de apoyo x2



G/ Pata x5



H/ Base



I/ Rueda x7



J/ Elevador de gas



K/ Mandos x2

Tornillos y otras piezas

1



x1

M5*8

2



x5

M6*16

3



x12

M6*20

4




x1

Llave Allen


1 Instalación de la base

- ① Retire la cubierta de plástico de la base.
- ② Inserte cada uno de los cinco pies en la base y fíjelos con tornillos.

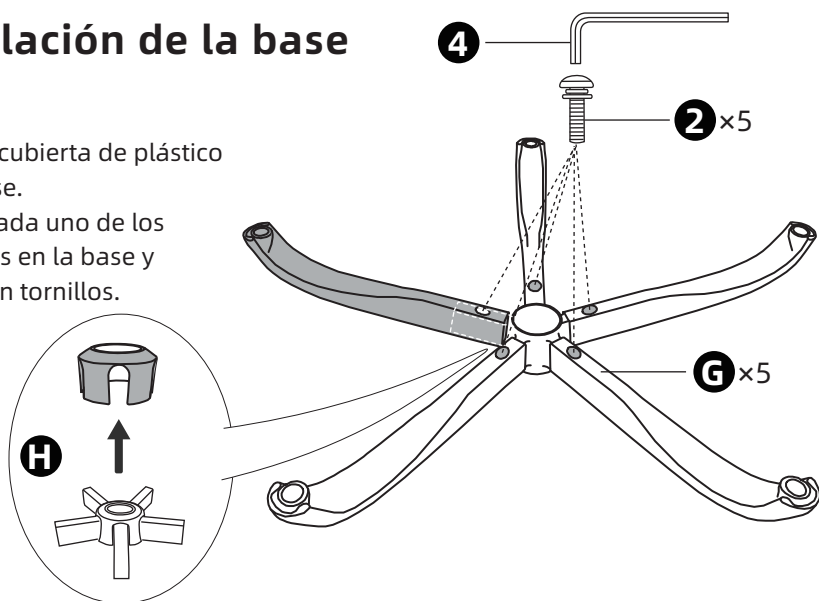


2 Instalación de ruedas y cubierta de plástico

- ① Dé la vuelta a la base e inserte las cinco ruedas de nailon en las ranuras de la parte inferior de la base.
- ② Inserte la tapa de plástico en el centro de la base.

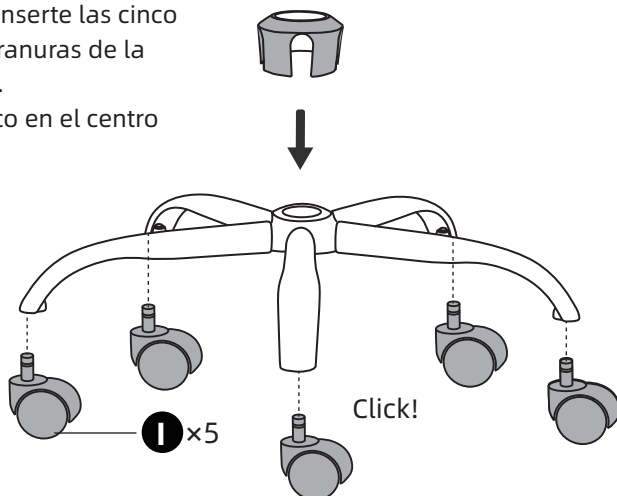


3 Instalación del marco de hierro del reposapiés

- ① Inserte el marco de hierro en el deslizador del reposapiés y fíjelo con un tornillo.

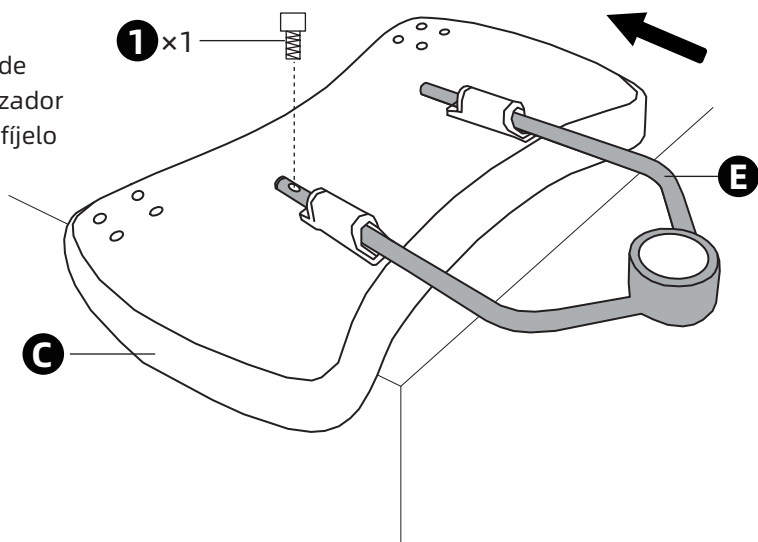


4 Instalación del pie de apoyo

- ① Inserte las dos ruedas de nylon en la parte inferior de las patas de apoyo.
② Fije las patas de apoyo al reposapiés.

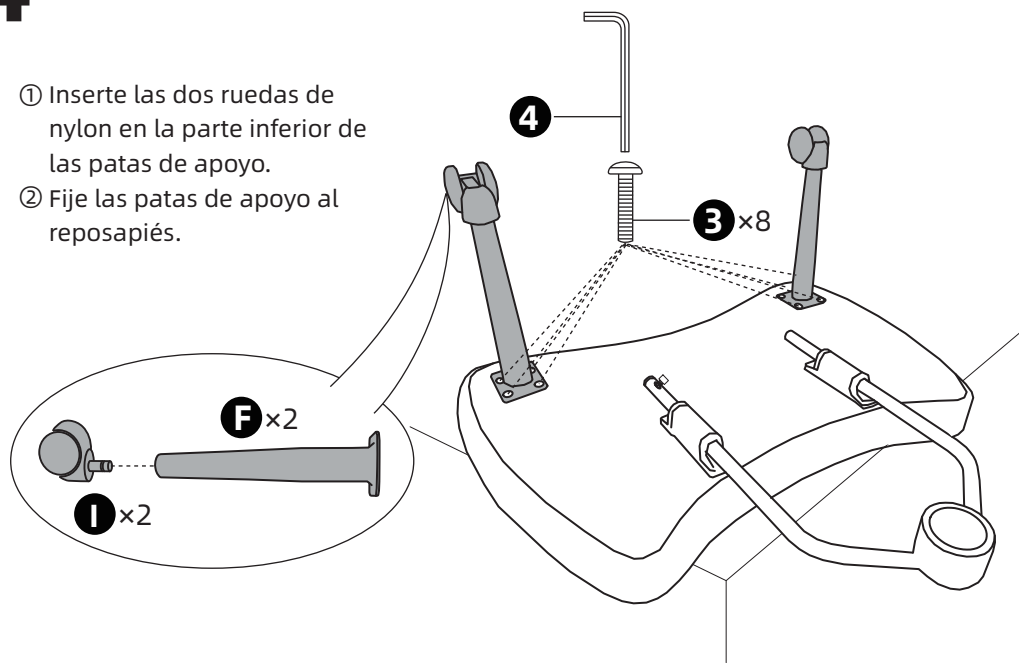

5 Instalación del elevador de gas y del pomo


- ① Inserte el elevador de gas en el reposapiés y en la base sucesivamente.
- ② Fije el elevador de gas con el pomo tal como se muestra.

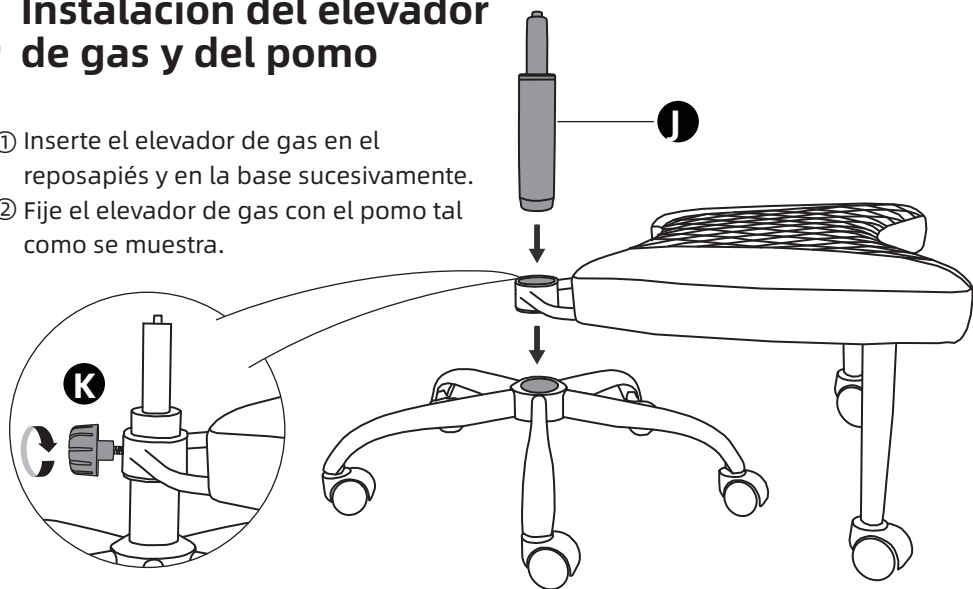

6 Instalación de la unidad de control en el asiento


- ① Apriete con los dedos todos los tornillos al 80%.
- ② Apriételos a fondo cuando todos estén colocados.

Nota: La dirección de montaje de la unidad de control puede determinarse por el adhesivo "FRONT" del asiento y la unidad de control.

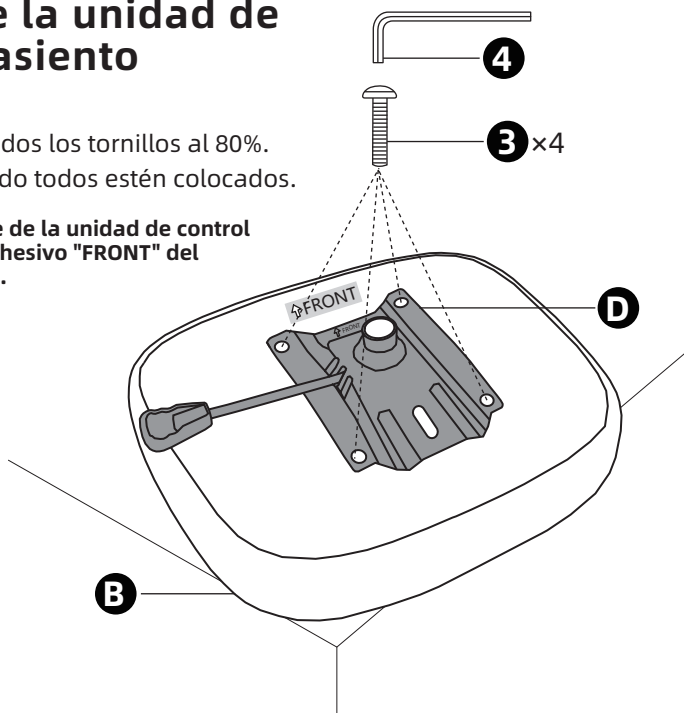


7 Combinación de asiento y respaldo

- ① Introduzca el respaldo en la unidad de control y fíjelo con el pomo.

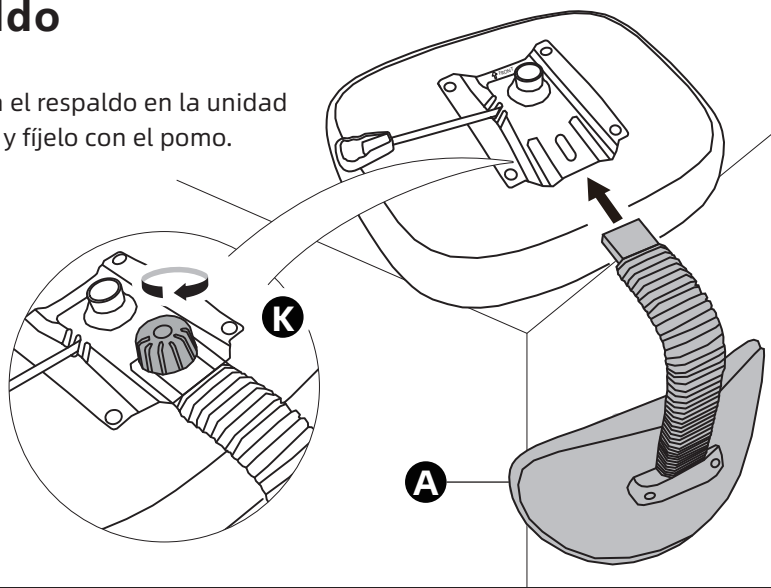


8 Fijación del asiento al elevador de gas

- ① Alinee y conecte las dos partes verticalmente.

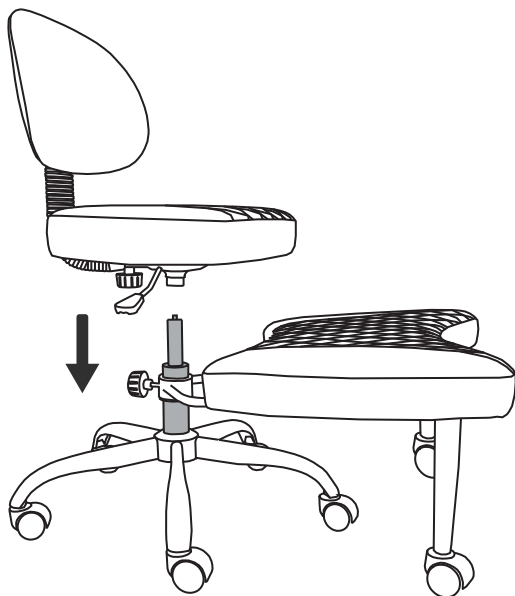


Ajuste de la altura del asiento y rotación de 360

- ① La silla está equipada con 10 cm (4 pulgadas) de ajuste de elevación, lo que permite a los usuarios ajustar la altura óptima para sentarse según sus necesidades de altura.
- ② Con la base giratoria flexible de 360° y las ruedas silenciosas, realiza una suave dirección libre de ángulos múltiples, disfrutando de la libertad de cambiar de posición sentado como desee.

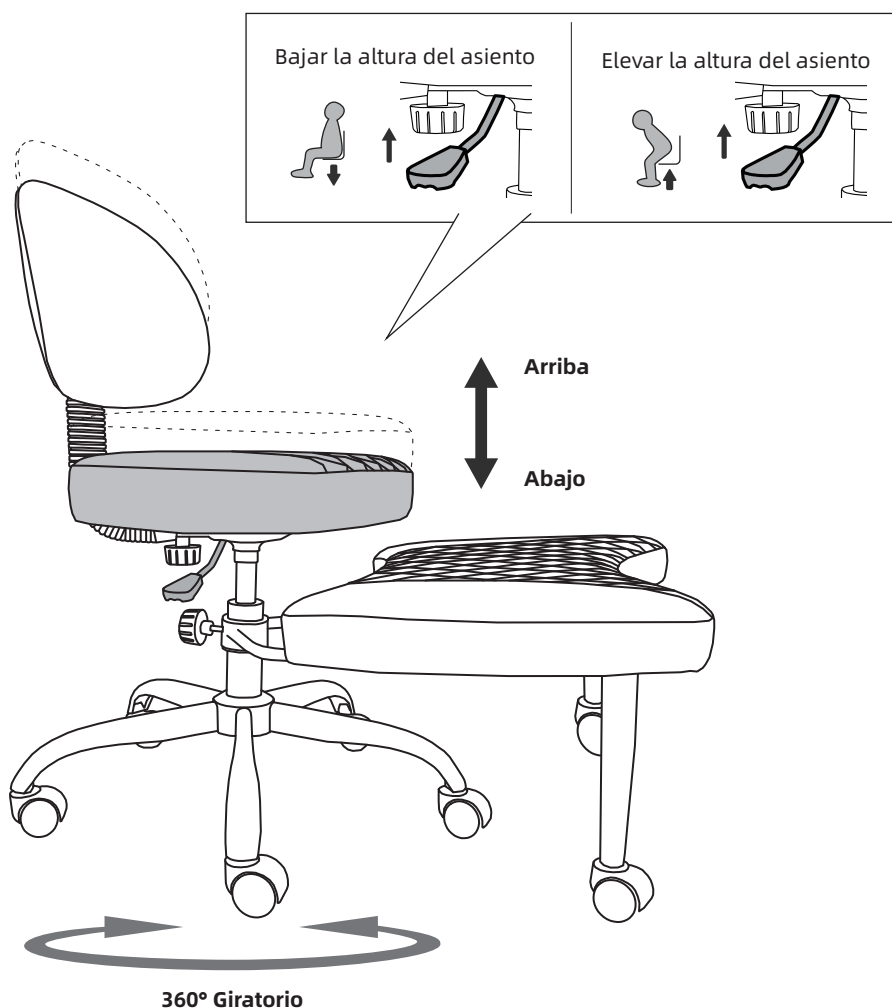


Reposapiés retráctil y rotación de 360

- ① Diseñado para múltiples posiciones de asiento, es adecuado para posturas con las piernas cruzadas, en cuclillas y de rodillas, y está equipado con giro de 360° y reposapiés retráctil para satisfacer las necesidades de los practicantes de yoga, los entusiastas de la meditación y las posturas de asiento dinámicas, proporcionando un apoyo flexible y una experiencia de comodidad ergonómica.

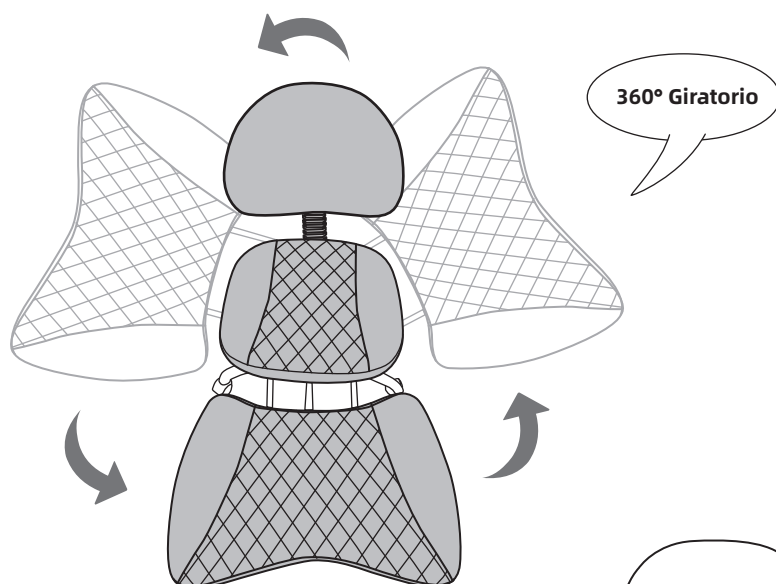

- ② Nota: Capacidad de carga limitada del reposapiés, no se permite sentarse.

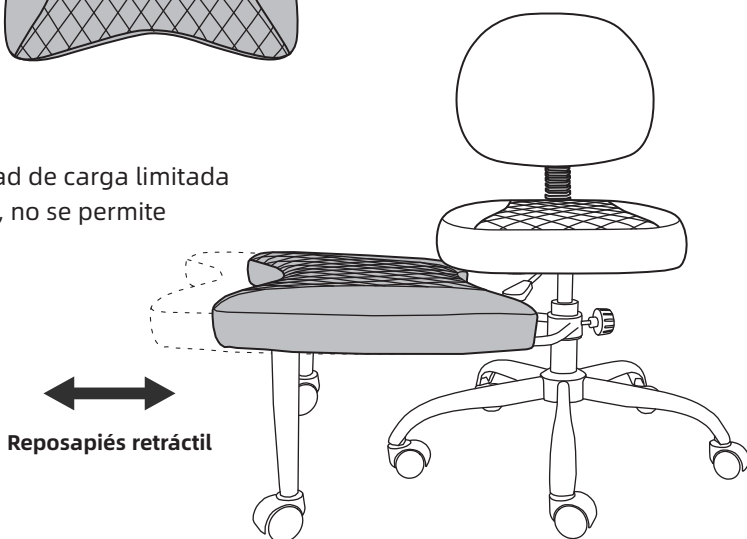

the 1990s, the number of people in the UK who are employed in the public sector has increased by 1.5 million, from 2.5 million in 1980 to 4 million in 1998. The public sector has become a major employer in the UK, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy.

The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy.

The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy.

The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy.

The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy.

The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy.

The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy. The public sector has also become a major source of social services, and its growth has been a key factor in the overall growth of the economy.